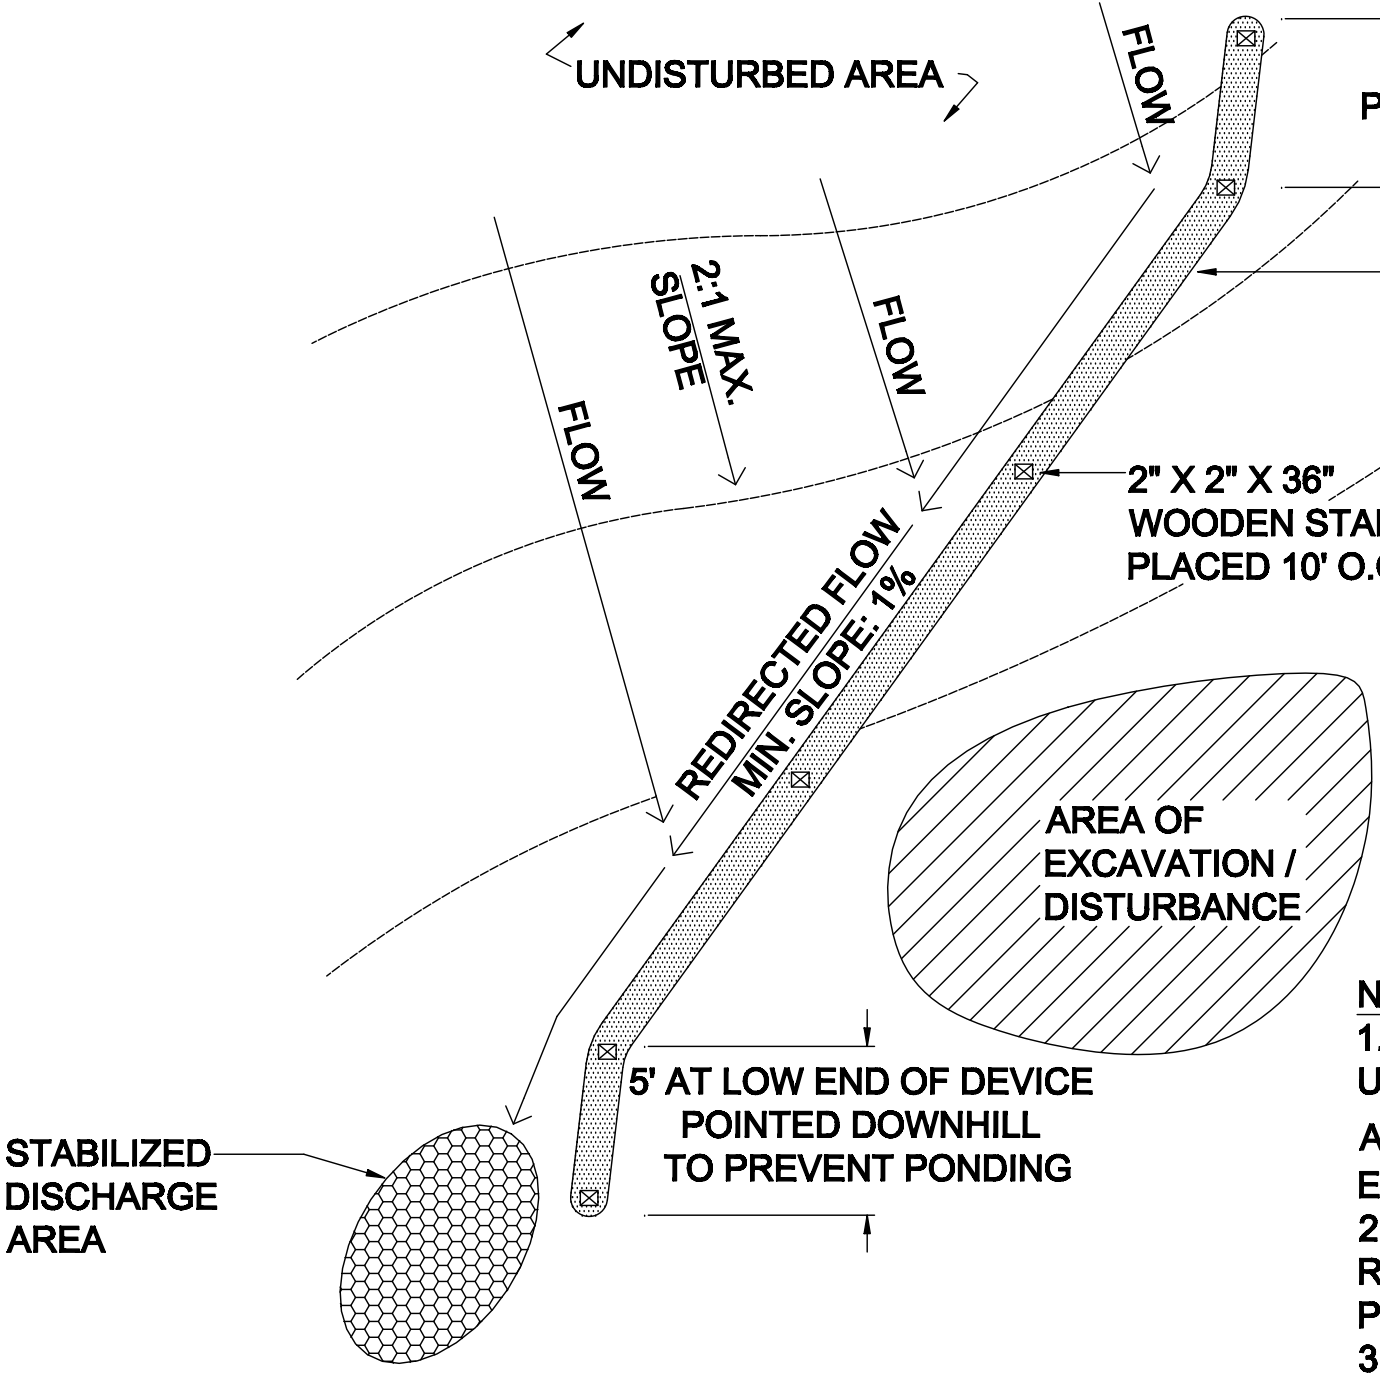

NOTES:

1. REMOVE SEDIMENT FROM THE UPSLOPE SIDE OF THE SOXX™ WHEN ACCUMULATION HAS REACHED ½ OF EFFECTIVE HEIGHT OF SOXX™
2. SLOPES GREATER THAN 5% MAY REQUIRE ADDITIONAL STABILIZATION PRACTICES
3. SOXX™ MAY BE SEEDED AT THE TIME OF INSTALLATION

FILTREXX® RUNOFF DIVERSION